

## List of Lighting Contractors

Company Name	Contact Name	Phone	Email
Lighting Labor Source, Inc.	Bill Hoover	805-231-8552	bhoover@lightinglabor.com
L&M Electric	Mark Schubert	661-269-2600	mrkillowatt1992@yahoo.com
Alliance Electrical Systems	Chris Fall	661-254-3800	chrisf@allianceelectricalsystems.com

**LIGHTING**

Here are the questions asked during the 2/28 walk-through:

Response Date: March 6, 2019

1) Does the job require using Prevailing Wage?

Answer: YES (see page 111 of LED Lighting Retrofit - Sample Short Form Agreement Documents 2-25-19)

2) Is a Performance Bond required? How much should the bond certificate be for?

Answer: YES (see page 106, Article 11 – INSURANCE AND BONDS in the “LED Lighting Retrofit - Sample Short Form Agreement Documents 2-25-19” document)

Answer: Performance Bond Amount is specified in the “RFP LED Lighting Retrofit 2-25-2019.”

3) What days/hours will be allowed to be onsite to work this job?

Answer: You are to propose installation days/hours that are the most competitive and economic approach for your business. All work hours are to be outside of school hours.

4) Confirming that contractors are to use only Design Light Consortium products.

Answer: YES



5) Broken Prismatic & Frosted light wrap covers - in Boys/Girls Gym locker room

Answer: Only all broken 2'x4' prismatic lens is to be replaced. Missing or special sizes are not to be included


6) RFP references "Plug N Play" in Prop-39 notes, are we to now use "Direct wired" LED lamps for this project?

Answer: YES. ACTON USD wants the fluorescent lamps and Ballast completely removed from the existing fixtures and upgraded with "Direct Wired" LED lamps for both school locations. Additionally, all lighting for class rooms are to be compliant with Illuminating engineering Society of North America (IESNA) averaging 35 foot-candles at desk height.

STUDENT DROP-OFF Antelope Woods Road

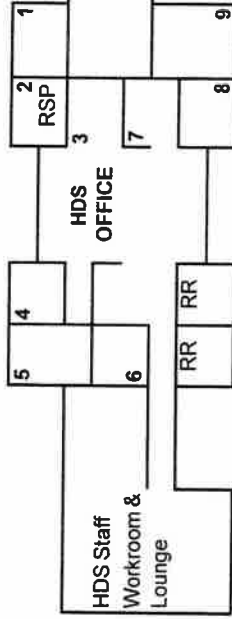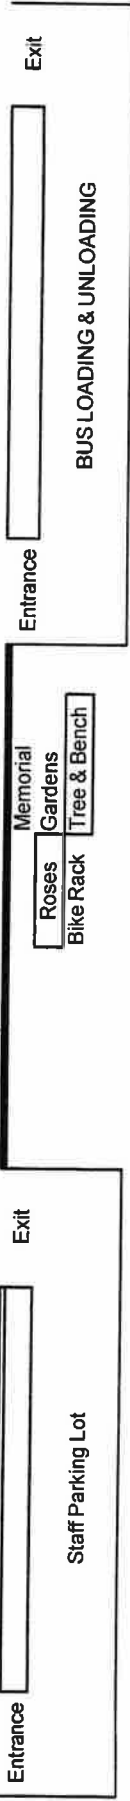


1. Office
2. Office
3. Secretary
4. Office
5. Conference Room
6. Health Office
7. Attendance Clerk
8. Office
9. Office
10. Snack Window
11. Cafeteria Serving Window
12. Indoor Stage
13. Outdoor Stage
14. Snack Window

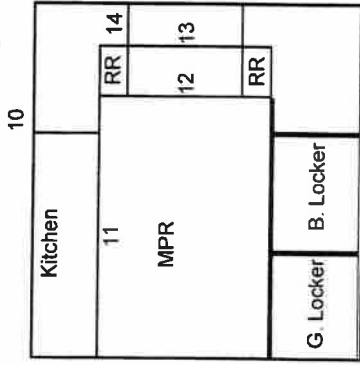

327  
Keyboarding

326  
PE, APE


To the Courts  
& Field

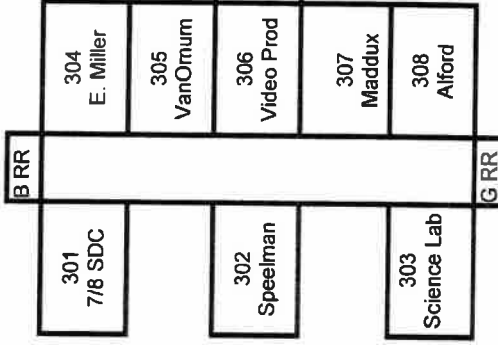

332  
Scripture

333  
Mitchell

QUAD

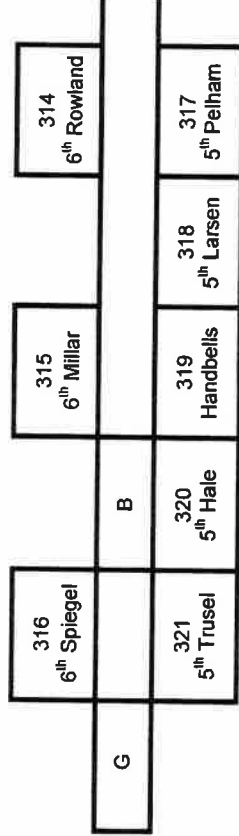

**MEADOWLARK CAMPUS**  
**3015 W. Sacramento Street, Acton, Ca. 91351**

**WATER MAIN**  


**ELECTRIC MAINS**  


**GAS MAINS**  


**LEGEND**

 = **WATER SHUT OFFS**

 = **ELECTRIC SHUT OFFS**

 = **GAS SHUT OFFS**

 = **FIRE PANEL**

